


**Water flow meter/totalizer shall be connected post filter. Meter Sterility cannot be guaranteed. Please note flow direction on filter. Following Filtration, do not drain water from filter. Please disconnect filter and place caps on ends while avoiding water loss. If Dechlorination is necessary, add Sodium Thiosulfate crystals to inlet side of filter capsule and seal with cap.**

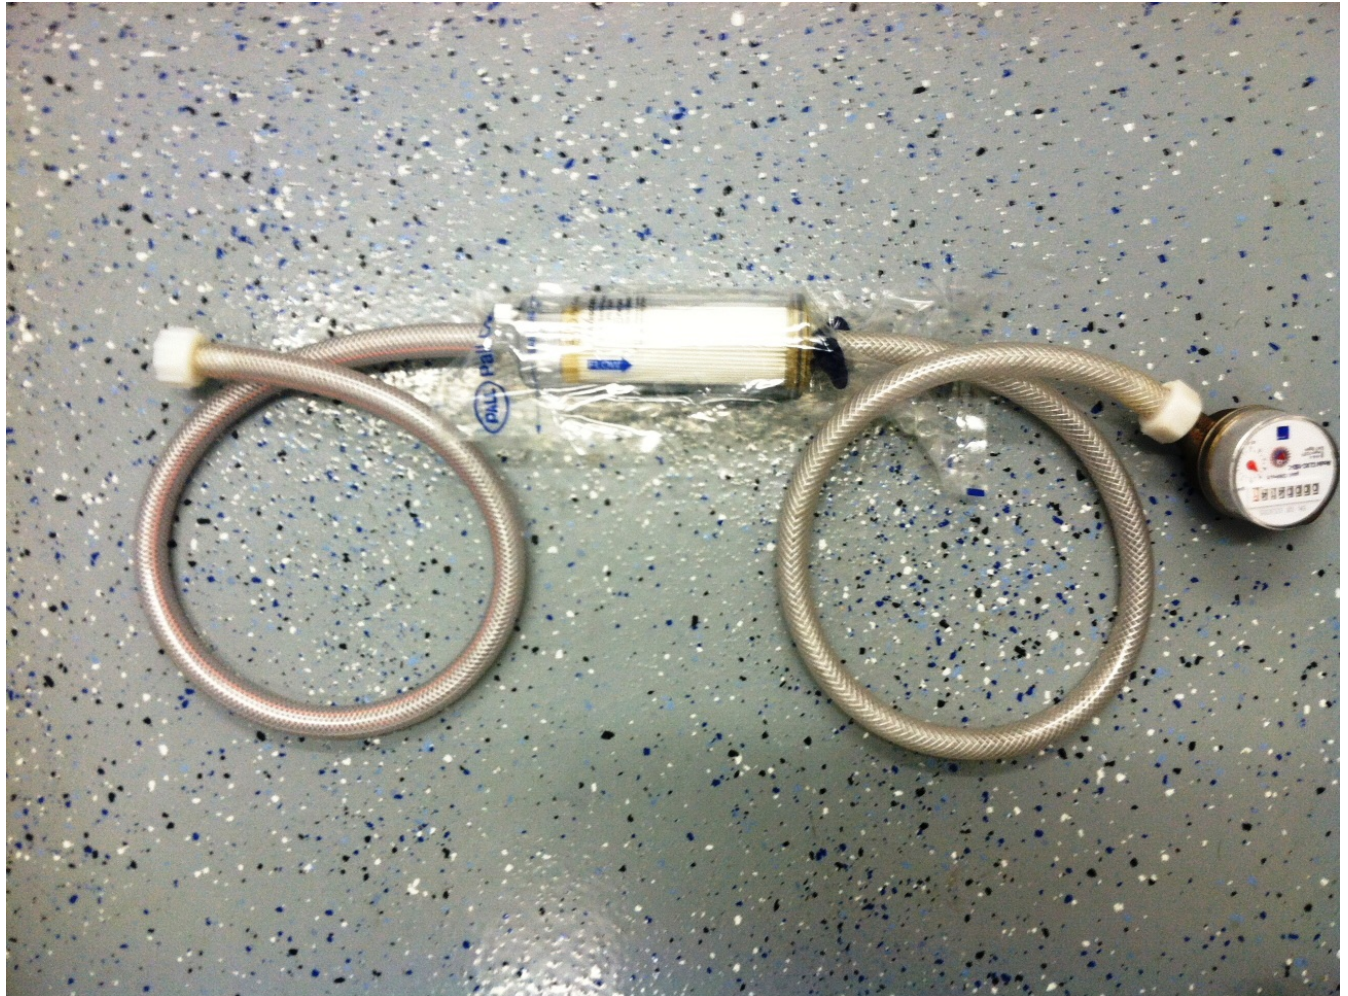

Water flow direction during sampling

Flow rate shall not exceed 0.5 gallons/ minute